

UCPB SAVINGS BANK, INC.
UCPBS BRANCHES GEN SET - UNDISPOSED FFE
JUN 02, 2026

ITEM DESCRIPTION	MODEL BRAND	QUANTITY	APPRAISED VALUE	STATUS
DIESEL ENGINE GENERATOR SET WITH SOUND PROOF ENCLOSURE	KIRLOSKAR	1	8,500	UNSERVICEABLE
DIESEL ENGINE GENERATOR SET WITH SOUND PROOF ENCLOSURE	CAMPER CUMMINS	1	140,000	SERVICEABLE
DIESEL ENGINE GENERATOR SET WITH SOUND PROOF ENCLOSURE	CAMPER CUMMINS	1	190,000	SERVICEABLE
DIESEL ENGINE GENERATOR SET WITH SOUND PROOF ENCLOSURE	CAMPER CUMMINS	1	140,000	SERVICEABLE

--	--	--

GUIDELINES







- Please submit Forms (Offer to Purchase) & contact UCPB Savings General Services Department.
- Property, Plant and Equipment must be inspected by the Buyer prior Offer to Purchase
- The Property, Plant and Equipment shall sold on an "As Is Where Is" policy.

Please contact : Mr. Dennis Moslares



DDMoslares@ucpbsavings.com

0998-842-6952

RIZAL AVENUE GENERATOR

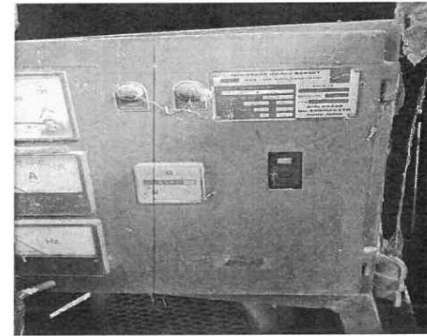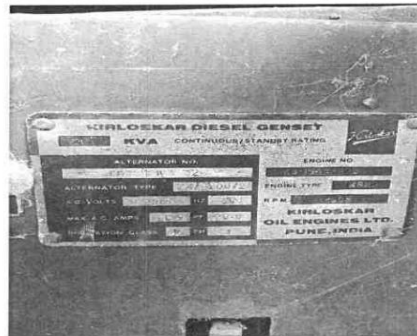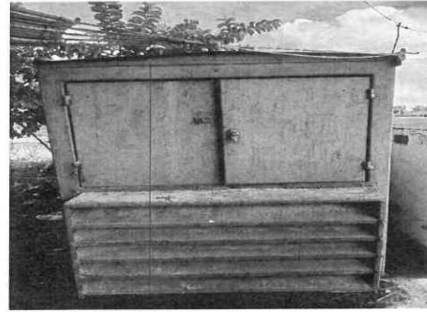
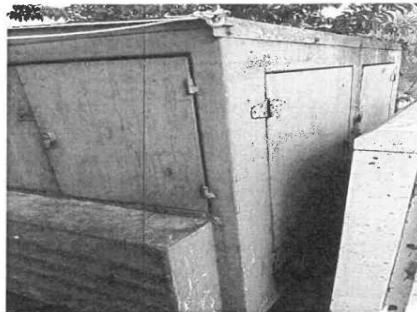
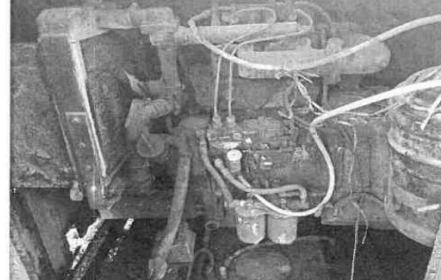
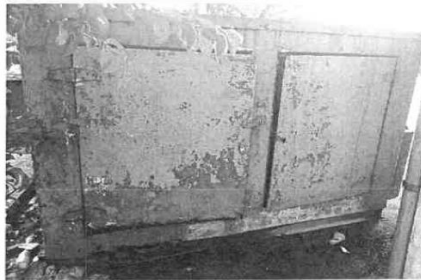


SJDM BULACAN GENERATOR

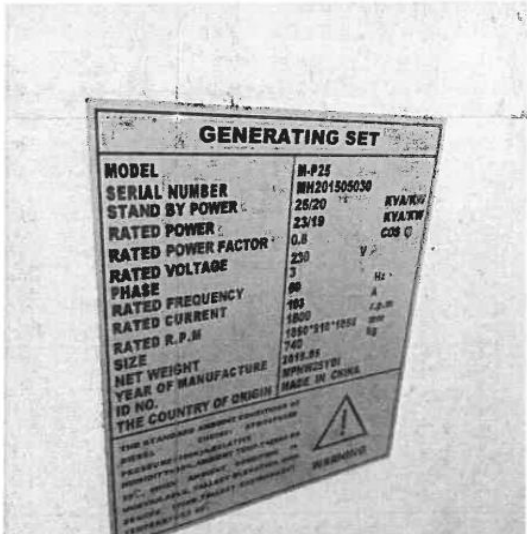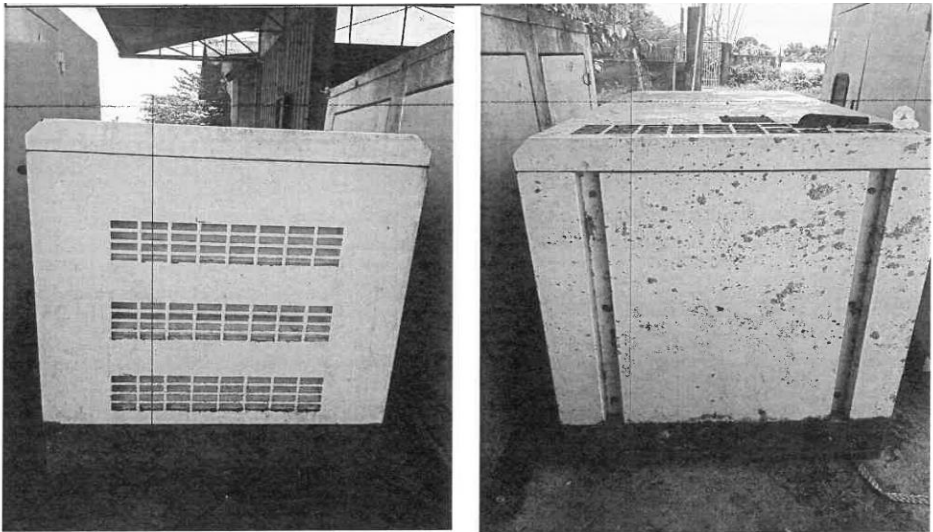



KALAYAAN GENERATOR

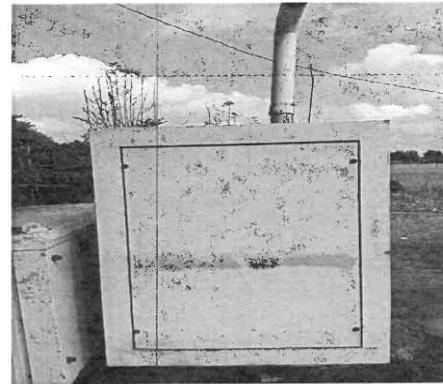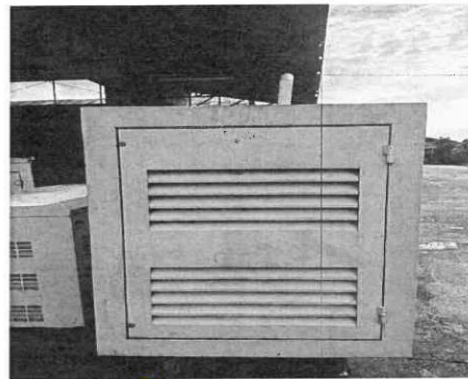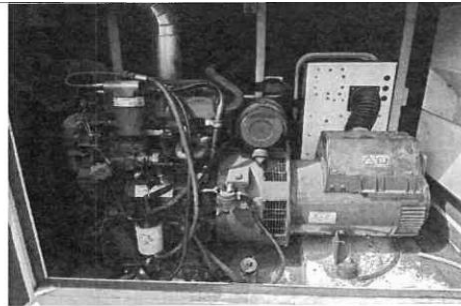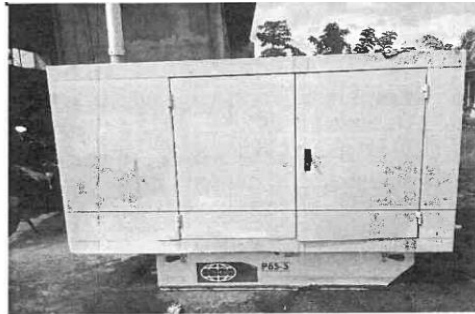

Old Glenarm Road, Larne, Co Antrim B1
Northern Ireland, United Kingdom
Tel: +44 (0) 28 28261000 Fax: +44 (0) 28 28261001
www.FGWilson.com

GENERATING SET		ISO 8528-3
MANUFACTURER	FGWILSON	
MODEL	P65-3	
SERIAL NO	5081785/80	
SALES ORDER REF	2014	
YEAR OF MANUFACTURE	2014	
AMBIENT TEMP	25	°C
RATED POWER	75	kVA
STANDBY	60	kVA
PRIME	55	kVA
RATED VOLTAGE	400	V
PHASE	3	
POWER FACTOR	0.8	
ALTERNATOR CONNECTION	Y	
INSULATION CLASS	F	
EXCITATION VOLTAGE	240	V
EXCITATION CURRENT	15	A

RATED VOLTAGE	400	V
PHASE	3	
RATED POWER FACTOR	0.8	
RATED FREQUENCY	50	Hz
RATED CURRENT - STANDBY	180	A
RATED CURRENT - PRIME	150	A
RATED RPM	1800	
ALTITUDE	100	m
ALTERNATOR CONNECTION	Y	
ISO 8528-3 RATING	P	
ALTERNATOR ENCLOSURE	PR	
INSULATION CLASS	F	
EXCITATION VOLTAGE	240	V
EXCITATION CURRENT	15	A

TANAY GENERATOR

